



**Three-phase energy meter DSZ15D-3x80A with display and MID approval**

**Only skilled electricians may install this electrical equipment otherwise there is the risk of fire or electric shock!**

Temperature at mounting location: -25°C up to +70°C.  
 Storage temperature: -25°C up to +70°C.  
 Relative humidity: annual average value <75%.

**Maximum current 3x80 A. Standby loss 0.5 watt per path only.**

Modular device for DIN-EN 60715 TH35 rail mounting in distribution cabinets with IP51 protection class. 4 modules = 70 mm wide and 58 mm deep.  
 Accuracy class B (1%). With S0 interface as standard.  
 It measures active energy by means of the current between input and output. The internal power consumption of 0.5 watt active power per path is neither metered nor indicated.  
 1, 2 or 3 phase conductors with max. currents up to 80 A can be connected.  
 The inrush current is 40 mA.  
 The N terminal must always be connected.  
 The consumption value is stored in non-volatile memory and is displayed again immediately after a power failure.


**The 7 segment LC display is also legible twice within a period of 2 weeks without power supply.**

Power consumption is shown by a bar flashing at a rate of 100 times per kWh.  
**Designed as standard for using as double-tariff meter:** Switch over to a second tariff by applying 230 V to terminals E1/E2.  
 On the right next to the display are the keys MODE and SELECT. Press them to scroll through the menu. First the **background lighting** switches on. The display then shows the total active energy per tariff, the active energy of the resettable memory RS1 or RS2 as well as the instantaneous values of consumption, voltage and current per phase.


**Error message (false)**

When the phase conductor is missing or the current direction is wrong 'false' and the corresponding phase conductor are indicated on the display.

**Typical connections:**  
 4-wire-connection 3x230/400V tariff 1

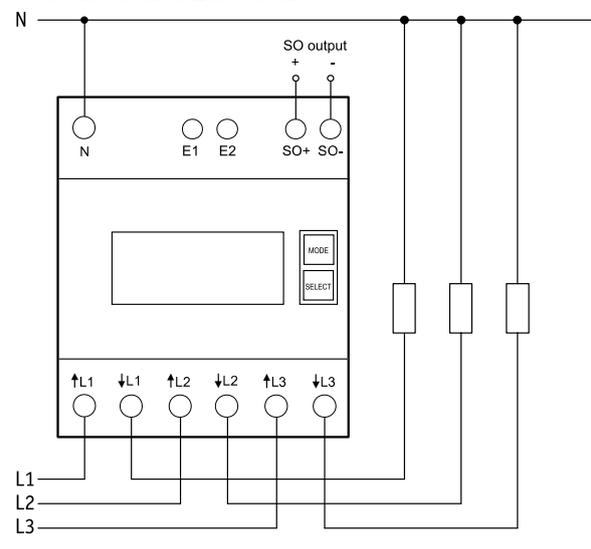

4-wire-connection 3x230/400V tariff 2

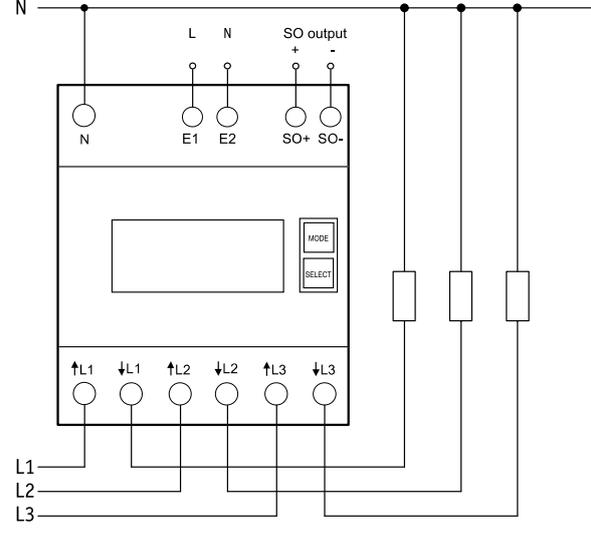


**Technical data**

|   |  |
|---|--|
| Rated voltage, extended range                             | 3x230/400 V, 50 Hz, -20%/+15%  |
| Reference current $I_{ref}$ (Limiting current $I_{max}$ ) | 3x0.5 - 10(80)A  |
| Internal consumption active power                         | 0.5 W per path   |
| Display   | LC display 7 digits, therefrom 1 or 2 digits after the decimal point   |
| Accuracy class ±1%  | B  |
| Inrush current according to accuracy class B              | 40 mA  |
| Operating temperature                                     | -25/+70°C  |
| Interface   | Pulse interface S0 according to DIN EN 62053-31, potential free by opto-coupler, max. 30 V DC/20 mA and min. 5 V DC, impedance 100 ohms, pulse length 30 ms, 1000 Imp./kWh |
| Terminal cover sealable                                   | Terminal cover claps   |
| Protection degree   | IP50 for mounting in distribution cabinets with protection class IP51  |
| Maximum conductor cross section <sup>1)</sup>             | L terminals 25 mm <sup>2</sup> , N terminals 16 mm <sup>2</sup> , S0 terminals and tariff terminals 6 mm <sup>2</sup>  |
| Recommended torque <sup>2)</sup>                          | L terminals 2,0 Nm (max. 2,5 Nm)<br>N terminals 1,5 Nm (max. 2,0 Nm)<br>S0 terminals and tariff terminals 0,8 Nm (max. 1,2 Nm)   |
| EC type examination certificate                           | 0120/SGS0204   |
| The energy meter is used indoors.                         |  |
| Mechanical environmental conditions                       | class M1   |
| Electromagnetic environmental conditions                  | class E2   |

<sup>1)</sup> The carrying capacity of cables and wires is defined in DIN VDE 0298-4.  
<sup>2)</sup> The torques for screw terminals are mentioned in DIN EN 60999-1.  
**To avoid damages at the energy meter, the recommended torque values for each terminal must not be exceeded!**

## Menu guidance

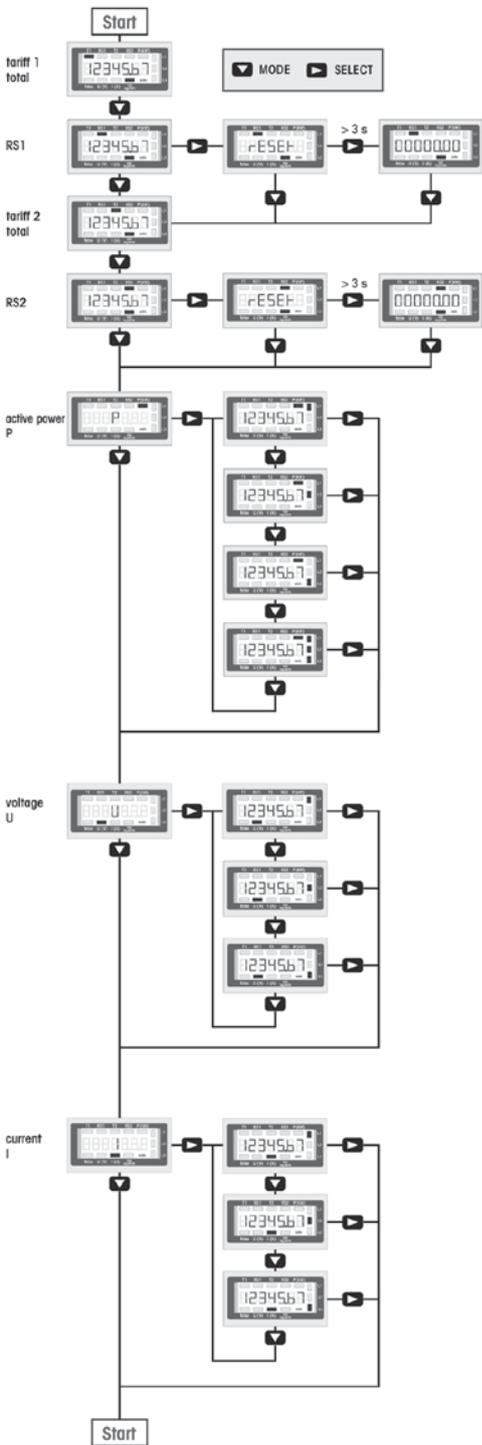

## EC DECLARATION OF CONFORMITY

Product **Three-phase energy meter with MID approval**

Type designation **DSZ15D-3x80A**

EC-type examination **0120/SGS0204**  
certificate

The manufacturer herewith declares, on his own responsibility that the designated products which this certificate refers to, are in accordance with the following harmonized standards or normative documents as well as with the following Directives of the European Parliament and of the Council ( relevant version ):

DIN EN 50470 part 1: 2019-08 and part 3: 2020-03 ( electronic meters )  
2014 / 32 / EU measuring instruments  
2014 / 30 / EU electromagnetic compatibility  
2011 / 65 / EU restriction of the use of certain hazardous substances ( RoHS Directive )

The designated products are placed on the market by **ELTAKO GmbH**,  
Hofener Straße 54 , 70736 Fellbach, Germany.

Notified body **SGS Fimko OY, No. 0598**  
Takomitie 8, FI-00380 Helsinki, Finland

Manufacturer **Shenzhen Chuangren Technology Co. Ltd.**  
Building 33, No.3 Industrial Area, Mashantou, Gongming Street,  
New Guangming District, Shenzhen City, Guangdong Province, 518106, China

Place, Date **Shenzhen, 25 February 2021**

Signature




This declaration proves the compliance with the above-mentioned EC Directives but it does not include any assurance of properties.  
Security advices of the provided product information have to be noticed.

## Manuals and documents in further languages:



[https://eltako.com/redirect/DSZ15D-3\\*80A\\_MID](https://eltako.com/redirect/DSZ15D-3*80A_MID)

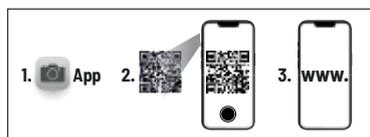

## Must be kept for later use!

We recommend the housing for operating instructions GBA14.

## ELTAKO GmbH

D-70736 Fellbach

### Technical Support English:

+49 711 94350025

technical-support@eltako.de

eltako.com